


Asbestos Risks

📅 Thu, Jan 18, 2024 📁 Buildings

An Asbestos Record can have a Risk set against it. Asbestos Risks provide extra safety information to the User upon starting works at the Site. The Asbestos Risk section in Core Data allows the Client to specify other Asbestos Risks should they require other Risks (or would like to rename the provided Risks).

1. Choose Building > Asbestos Risks from the Core Data menu.
2. Once open, a list of Asbestos Risks is displayed. Here, it is possible to choose which Risks are applicable by ticking and un-ticking the desired items. There is also the ability to add items using the "Add" button or to edit items using the "Edit" button.

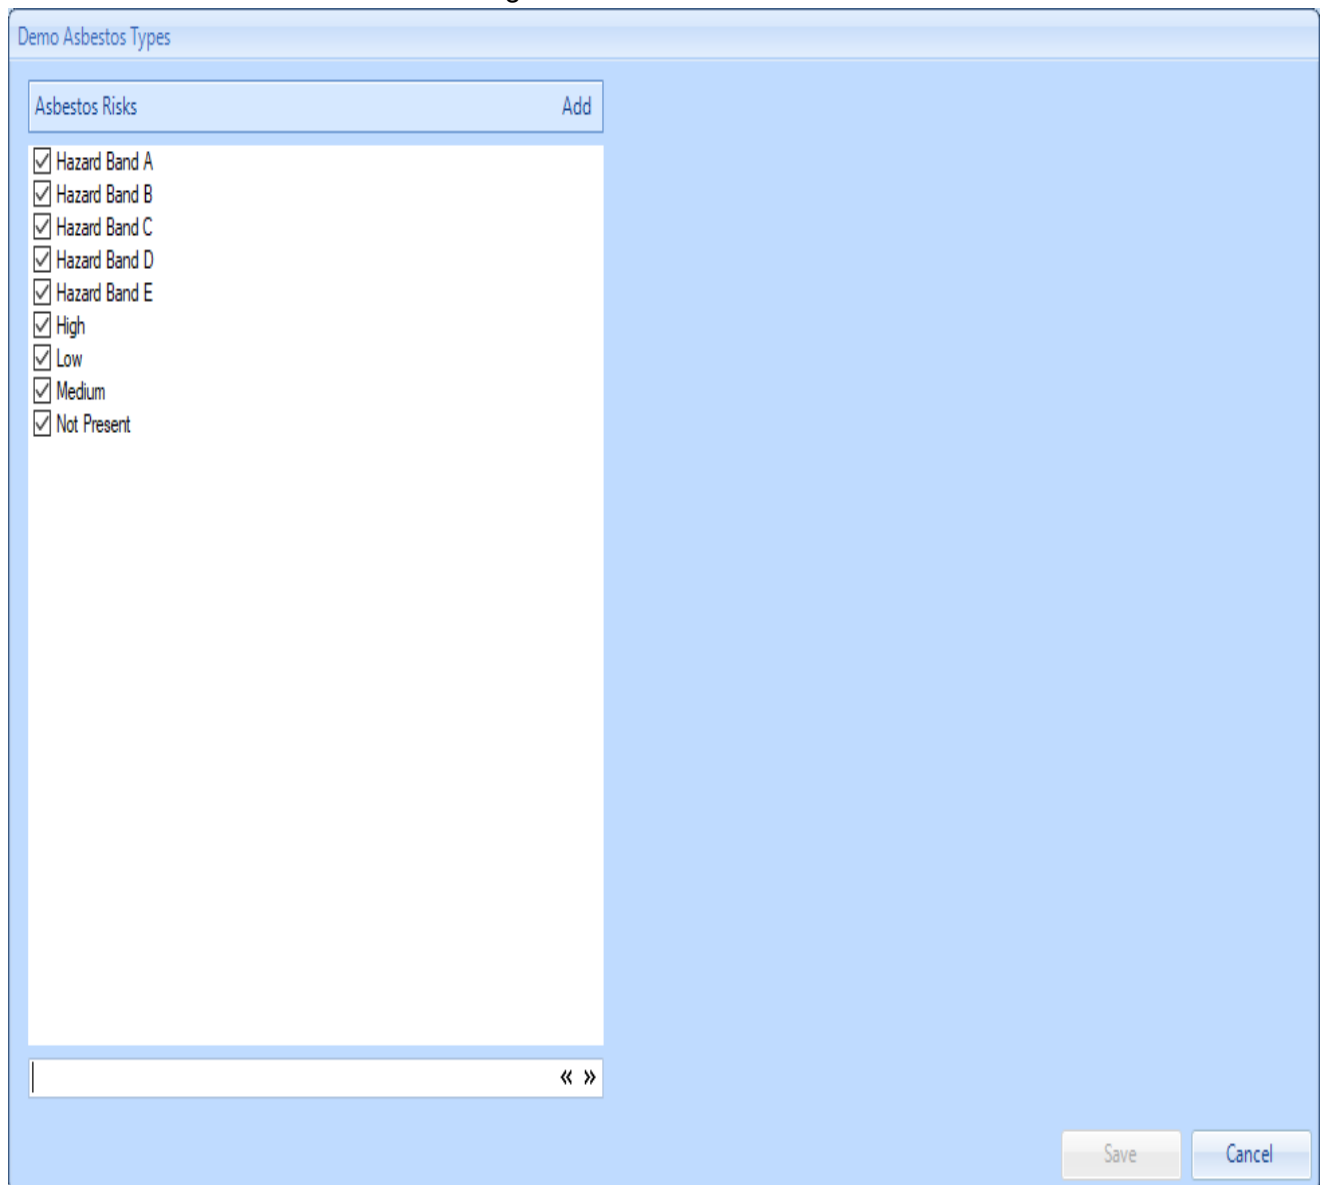


The screenshot shows a software window titled "Demo Asbestos Types". Inside, there is a section labeled "Asbestos Risks" with an "Add" button to its right. Below this, a list of risk categories is displayed, each with a checked checkbox:

- ☒ Hazard Band A
- ☒ Hazard Band B
- ☒ Hazard Band C
- ☒ Hazard Band D
- ☒ Hazard Band E
- ☒ High
- ☒ Low
- ☒ Medium
- ☒ Not Present


At the bottom of the list is a text input field and a pair of navigation arrows (double left and double right). In the bottom right corner of the window are "Save" and "Cancel" buttons.

3. When adding, on clicking the Add button, the Add Asbestos Risk screen will appear. All that is required here is the name of the Risk and a Value. The Value determines which order the Risk will appear in the drop down on the Asbestos Record. Click "OK" to apply the changes.

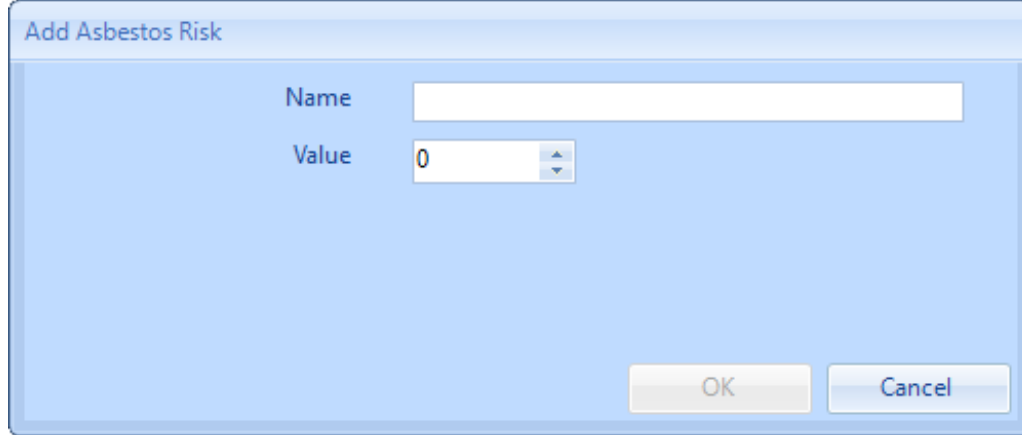

A dialog box titled "Add Asbestos Risk" with a light blue background. It contains two labels: "Name" and "Value". The "Name" label is positioned to the left of a text input field. The "Value" label is positioned to the left of a numeric spinner control showing the value "0". At the bottom right, there are two buttons: "OK" and "Cancel".

4. After selecting "Edit", the Edit Asbestos Risk screen is displayed. As with the "Add" function, all that is required here is a change of the name of the Risk and the Value. Click "OK" to apply the changes.

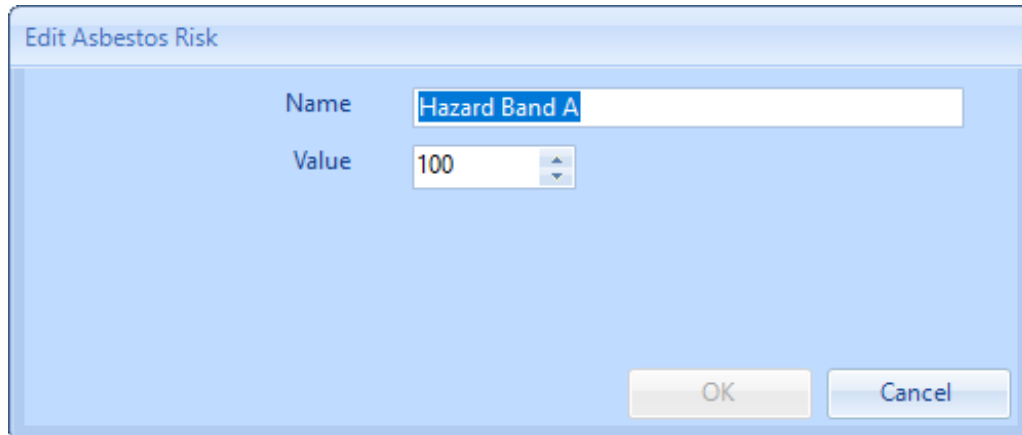

A dialog box titled "Edit Asbestos Risk" with a light blue background. It contains two labels: "Name" and "Value". The "Name" label is positioned to the left of a text input field containing the text "Hazard Band A". The "Value" label is positioned to the left of a numeric spinner control showing the value "100". At the bottom right, there are two buttons: "OK" and "Cancel".

Once all the changes have been made, click "Save" to apply them.

Online URL: <https://ostarasystems.knowledgebase.co/article.php?id=674>